




A	CV 2'-2	126% 126% 126%	同上
	CV 2'-4	126% 126% 126%	同上
	CV 2'-6	126% 126% 126%	同上
B	CV 2'-2	126% 126% 126%	同上
	CV 2'-4	126% 126% 126%	同上
	CV 2'-6	126% 126% 126%	同上
C	CV 2'-2	126% 126% 126%	同上
	CV 2'-4	126% 126% 126%	同上
	CV 2'-6	126% 126% 126%	同上
D	CV 2'-2	126% 126% 126%	同上
	CV 2'-4	126% 126% 126%	同上
	CV 2'-6	126% 126% 126%	同上
E	CV 2'-2	126% 126% 126%	同上
	CV 2'-4	126% 126% 126%	同上
	CV 2'-6	126% 126% 126%	同上

F	CV 2'-2	126% 126% 126%	同上
	CV 2'-4	126% 126% 126%	同上
	CV 2'-6	126% 126% 126%	同上

記号	名称	W	D	H	備
①	NO.1 埋設配線用ケーブル	11	30	50	埋設配線用
②	NO.2	-	-	-	-
③	NO.1 埋設配線用ケーブル	-	-	-	-
④	NO.2	-	-	-	-
⑤	NO.1	5.5	30	22	埋設配線用
⑥	NO.2	-	-	-	-
⑦	NO.1 埋設配線用ケーブル	11	30	50	埋設配線用
⑧	NO.2	-	-	-	-
⑨	埋設配線用ケーブル	4.5	30	20	埋設配線用
⑩	埋設配線用ケーブル	5.5	30	22	埋設配線用
LF1		2	3	3P	SUS
LF2					

阿賀川 →

提防

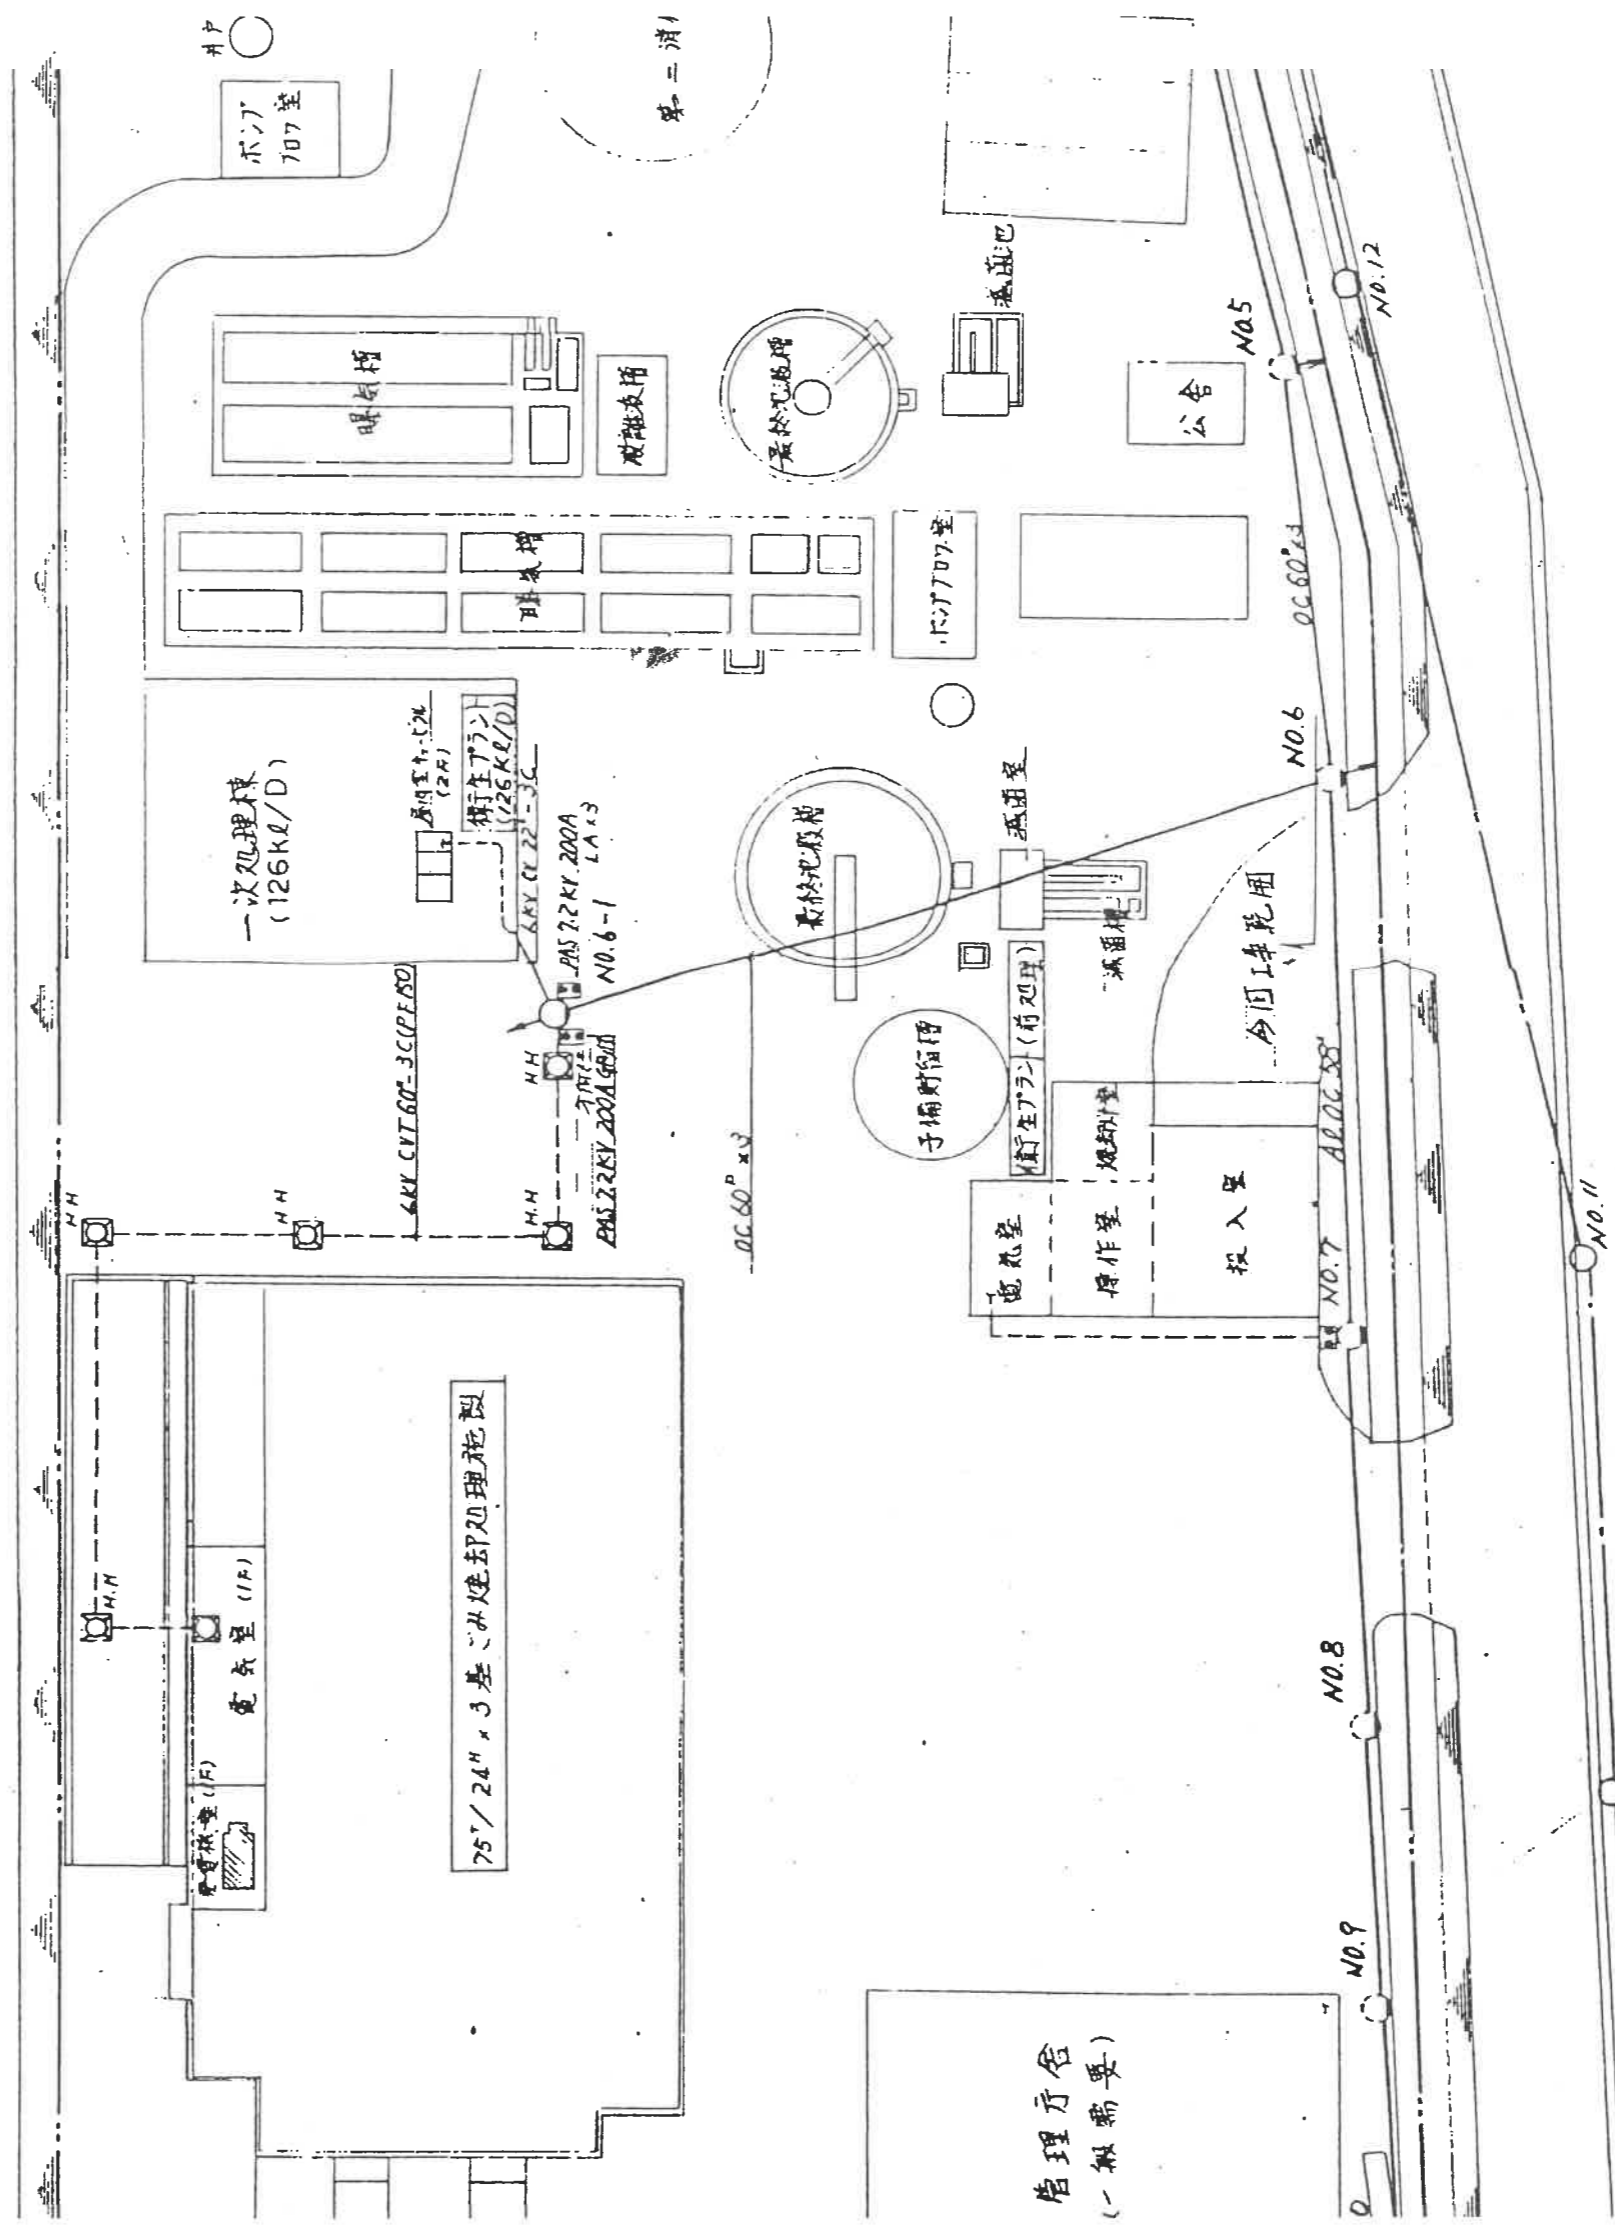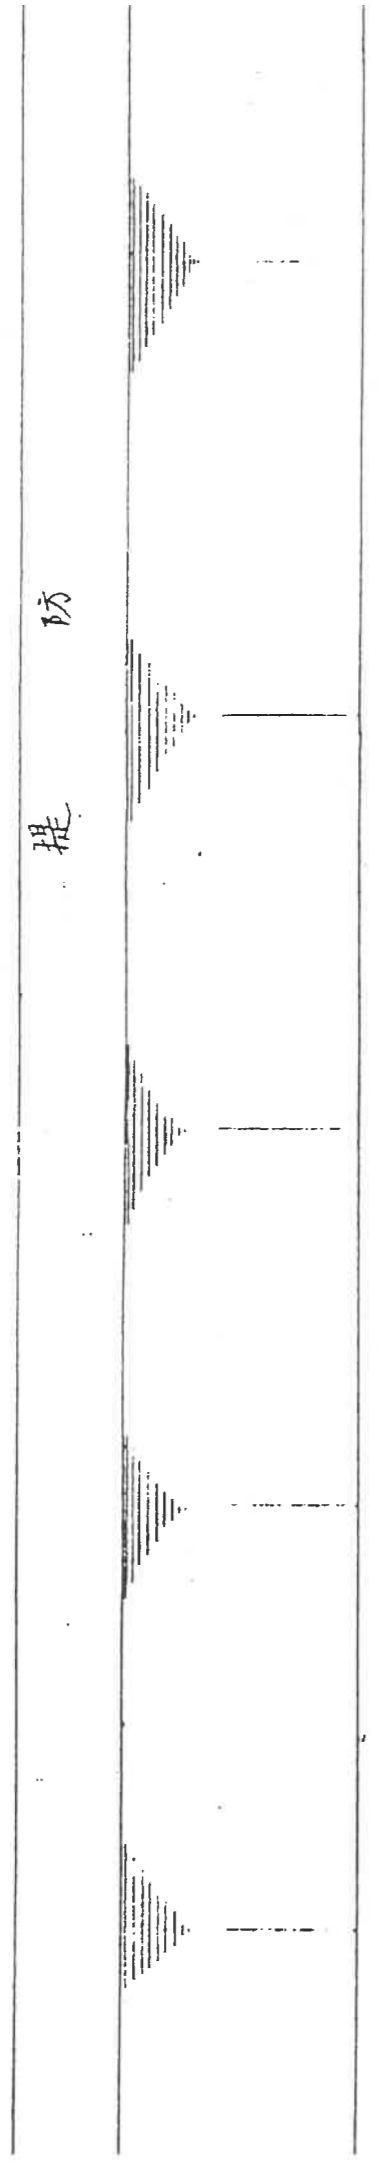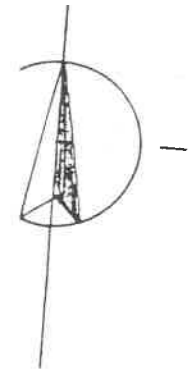

場線 (東北電力配線) No.10

申請場所 (金津地区広域事務組合)
福島県会津若杉市神指町大字南四合字
深川西 292 番地 2

